



TEST REPORT

No. : SP100804721

Date : Sept.10,2014

Page: 1 of 3

The following sample(s) was/ were submitted and identified on behalf of the client as:

Sample Name : ALUMINIUM COMPOSITE PANEL
Sample No. : SP100804721
Product specification : 2440*1220*3MM
Brand : ~~WALBOND~~
Test Required : To determine the flammability (building materials class B2) in accordance with
DIN 4102-1 (May 1998) Fire behaviour of building materials and elements Part 1:
Classification of building materials, Requirements and testing
Date of Receipt : Aug.23,2014
Test Period : Aug.23,2014 to Sept.10,2014
Test result(s) : For further details, please refer to the following page(s)

***** To be continued*****

Signed for SGS-CSTC Standards
Technical Services (Shanghai) Co., Ltd

Ivy Zhu

Ivy Zhu

Authorized signatory

This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at http://www.sgs.com/terms_and_conditions.htm and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at www.sgs.com/terms_e-document.htm. Attention is drawn to the limitation of liability, jurisdiction and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its inspection and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated, the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.



SGS-CSTC Standards Technical Services (Shanghai) Co., Ltd
Testing Center

No.69, Block 1159, East Kang Qiao Road, Pudong District, Shanghai, China 201319 t(86-21)61196300 f(86-21)68183122/68183920 www.cn.sgs.com
中国·上海·浦东康桥东路1159弄69号 邮编:201319 t(86-21)61196300 f(86-21)68183122/68183920 e sgs.china@sgs.com

Member of the SGS Group (SGS SA)



TEST REPORT

No. : SP100804721

Date : Sept.10,2014

Page: 2 of 3

I. Test conducted

This test was conducted as per DIN 4102-1:1998 Clause 6.2. Classification in according to DIN 4102-1 (May 1998) Clause 6.2. Class B2 materials

II. Sample details

| | |
|---------------------|------------------------------|
| General description | Aluminium Composite Panel |
| Color / Density | White / 4.1kg/m ² |
| Size of Sample | 190×90mm×3mm |

Conditioning

Prior to testing, the sample was conditioned at least 14 days to constant mass at a temperature of 23 ± 2 °C, and a relative humidity of 50 ± 6 %.

III. Test results

Normal Flammability Test according to DIN 4102-1 Clause 6.2

Flame application: [] bottom edge ignition, [] surface ignition

| Specimen No. | 1 | 2 | 3 | 4 | 5 |
|---|--------|----|----|----|----|
| Reaching the measuring mark within 20 seconds | No | No | No | No | No |
| Self extinguishing of the flame (s) | 15 | 15 | 15 | 15 | 15 |
| Max. flame height (cm) | 2 | 2 | 2 | 2 | 2 |
| End of afterflaming (s) | 0 | 0 | 0 | 0 | 0 |
| End of afterglowing (s) | 0 | 0 | 0 | 0 | 0 |
| Molten dripping | No | No | No | No | No |
| Smoke developments (visual impression) | Slight | | | | |

All timings are from start of testing

Comments:

[] DIN 4102-B2; [] DIN 4102-B3

Criteria for classification for Class B2 (DIN 4102-1 Clause 6.2.2)

All materials, may be classed as B2 materials if they,

Pass DIN 4102-1 Clause 6.2.3 Ignitability Test

For each specimen, flaming doesn't reach the gage mark within 20s after flame application.

***** To be continued*****

This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at http://www.sgs.com/terms_and_conditions.htm and, for electronic format documents, subject to Terms and Conditions for Electronic Documents at www.sgs.com/terms_e-document.htm. Attention is drawn to the limitation of liability, jurisdiction and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its inspection and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated, the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.



SGS Standards Technical Services (Shanghai) Co., Ltd.
Testing Center

No.69, Block 1159, East Kang Qiao Road, Pudong District, Shanghai, China 201319 t(86-21) 61196300
中国·上海·浦东康桥东路1159弄69号 邮编:201319 t(86-21) 61196300

f(86-21) 68183122/68183920 www.cn.sgs.com
f(86-21) 68183122/68183920 e sgs.china@sgs.com

Member of the SGS Group (SGS SA)



TEST REPORT

No. : SP100804721

Date : Sept.10,2014

Page: 3 of 3


Conclusion: The tested sample **meets** the Normal flammability requirements of class B2 of building materials under DIN 4102-1 (May 1998).

STATEMENTS:

This test report does not replace any mandatory certification of the product that may be required.

The test results relate to the behaviour of the test specimens of a product under the particular conditions of the test; they are not intended to be the sole criterion for assessing the potential fire and smoke hazard of the product in use.

Sample Photo:

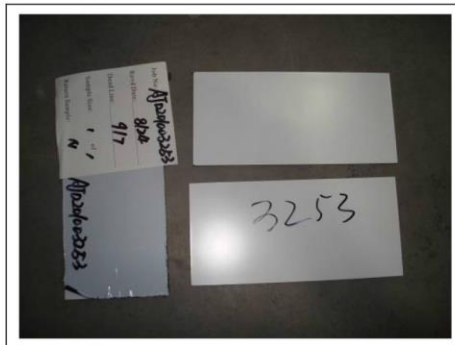

- The test was performed by SGS internal laboratory.

***** End of report *****

This document is issued by the Company subject to its General Conditions of Service printed overleaf, available on request or accessible at http://www.sgs.com/terms_and_conditions.htm and for electronic format documents, subject to Terms and Conditions for Electronic Documents at www.sgs.com/terms_e-document.htm. Attention is drawn to the limitation of liability, jurisdiction and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its issue and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law. Unless otherwise stated, the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 30 days only.



SGS Standards Technical Services (Shanghai) Co., Ltd.
Testing Center

No.69, Block 1159, East Kang Qiao Road, Pudong District, Shanghai, China 201319 t(86-21) 61196300 f(86-21) 68183122/68183920 www.cn.sgs.com
中国·上海·浦东康桥东路1159弄69号 邮编:201319 t(86-21) 61196300 f(86-21) 68183122/68183920 e sgs.china@sgs.com

Member of the SGS Group (SGS SA)